



ORIGINAL  
Make Copies

RECOMMENDED  
UNDERGROUND  
TEMP-POLE  
CONSTRUCTION ONLY  
T.V.E.C.  
SAVANNAH.TENN.

60 OR 100 AMP FUSED  
DISCONNECT  
  
MIN. 6 CIRCUITS  
FRONT VIEW OF DISCONNECT

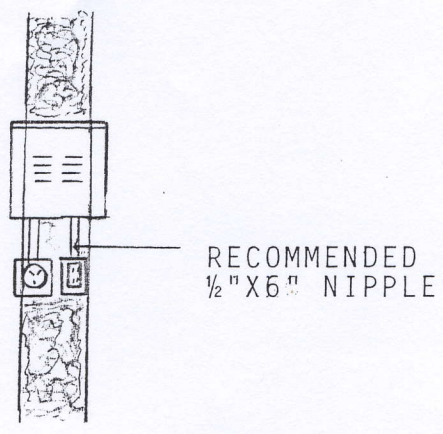

60 AMP #6 WIRE  
100 AMP #4 WIRE

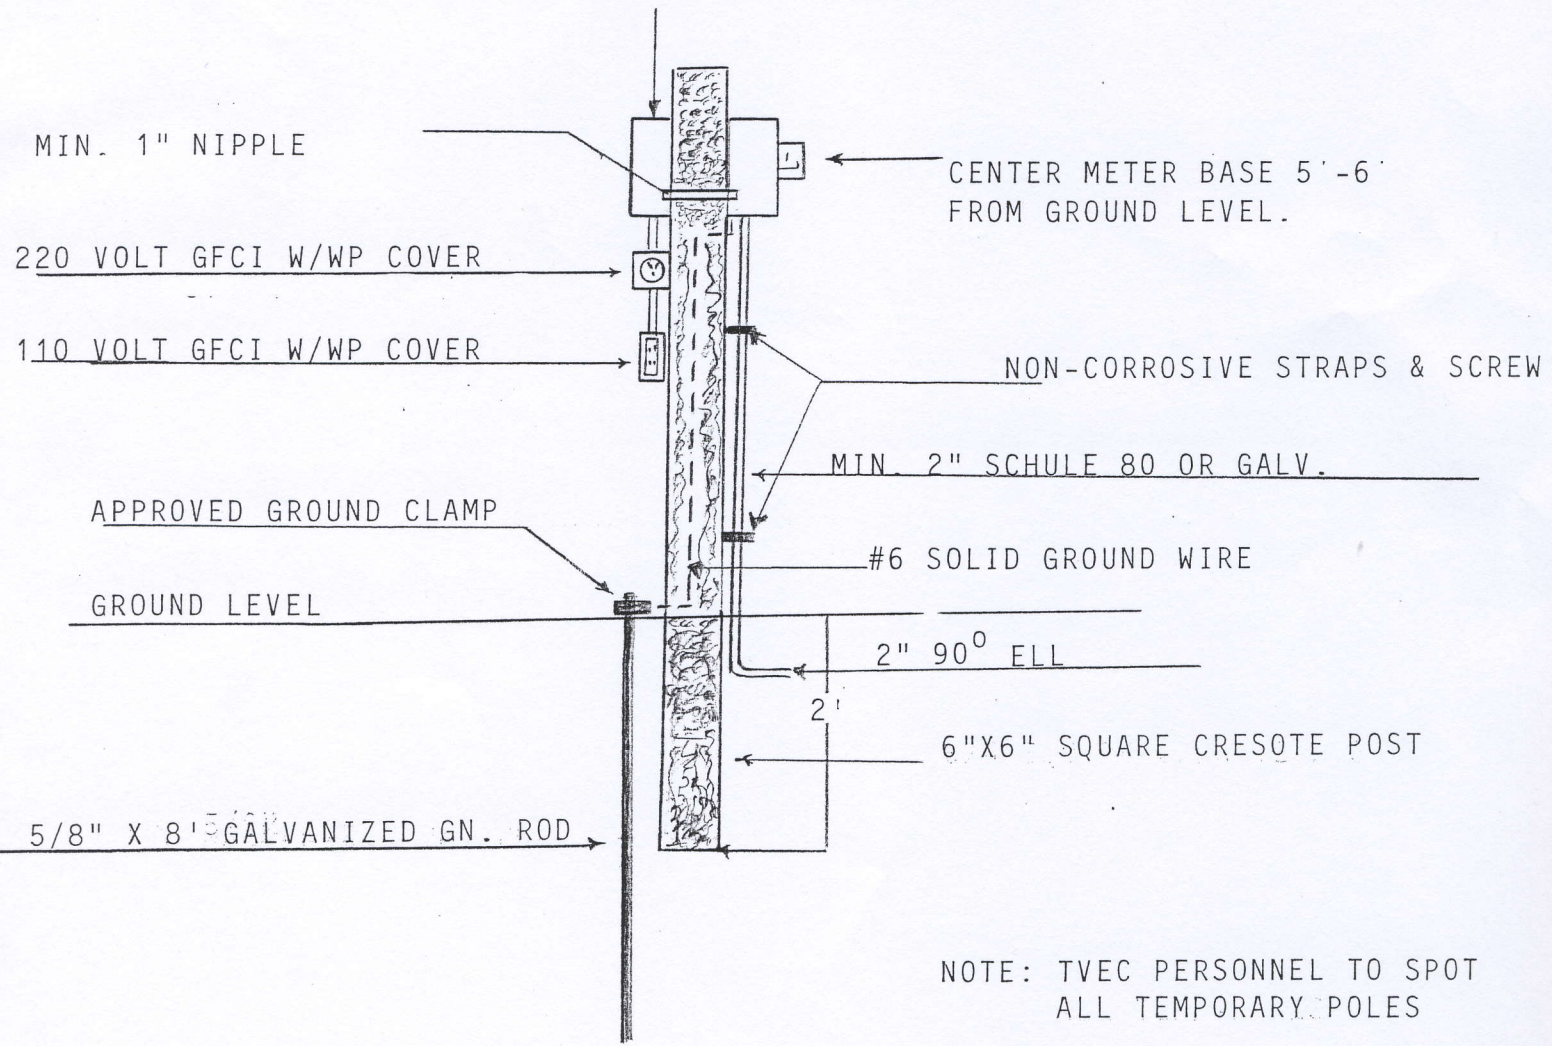

NOTE: TVEC PERSONNEL TO SPOT  
ALL TEMPORARY POLES